

StorageVET 2.0 Task Force

ESIC Working Group 1: Grid Services and Analysis

Miles Evans | EPRI

Halley Nathwani | EPRI

Giovanni Damato | EPRI

February 6, 2020



Antitrust Guidelines

Antitrust laws apply to EPRI, its members, funders, advisors, licensees, contractors, and vendors. Violations can lead to civil and criminal liability.

DO NOT DISCUSS...

- Pricing, production capacity, or cost information which is not publicly available;
- Sales territories, market shares, future product offerings;
- Confidential market strategies or business plans;
- Other competitively sensitive information;
- Advise or try to influence others on their business decisions (except to the extent that they are already public);
- Complaints or disparaging remarks concerning customers/suppliers/competitors.

DO NOT AGREE...

- To discriminate against or refuse to deal with a supplier (boycott);
- To only do business on certain terms and conditions;
- To set (or fix) prices;
- To divide markets or technologies;
- To allocate customers/suppliers/territories;
- To suppress a technology;
- To the use, promotion or endorsement of particular vendors, contractors, consultants or products.

Webcast and Recording Notification

- The webcast is being recorded along with all Q&A. Your participation provides consent to that recording.
- As a result, please make sure your phone is on mute throughout the webcast unless speaking. Do not place your phone on hold.

StorageVET 2.0 Task Force

ESIC Working Group 1: Grid Services and Analysis

Miles Evans | EPRI

Halley Nathwani | EPRI

Giovanni Damato | EPRI

February 6, 2020



Agenda

- ESIC In-Person Survey Results
- Reliability Use Case

ESIC In-Person Survey Results

ESIC Deliverable Survey Response Summary

- What ESIC products should we pursue for energy storage valuation and modeling in 2020?
- 32 responses
 - Most indicated StorageVET/DER-VET are the right deliverables
 - Many proposed specific modeling tool capabilities to engage with or case studies to perform

General Modeling Tool Development

- 9 Responses
 - 7 indicated StorageVET/DER-VET are the appropriate deliverables
 - 1 specifically called out value stacking
 - 1 asked for high performance computing support in StorageVET

Control and Uncertainty

- 5 Responses
 - Uncertainty when providing **regulation**
 - See user guide page 5-1
 - Uncertainty in wholesale market **prices**
 - Separate optimization vs evaluation data coming in DER-VET
 - Uncertainty in **load forecasts** when reducing **demand charges**
 - Multiple planning horizons difficult to handle meaningfully for every case
 - Extra SOC reservation
 - Uncertainty in the final results
 - Open-source controller

Technology Models

- 4 Responses
 - Thermal storage
 - Specifics on differentiating storage technologies in the models
 - Non-Lithium commercial options
 - PV + storage hybrid

Case Studies and Degradation

- Case studies
 - Value of long duration storage
 - PV + storage benchmarking
 - NWA
- Degradation
 - Cycle life
 - Life cycle cost assessment including extension of life
 - Life cycle cost including degradation, augmentation, over-sizing


Everything Else

- O&M
- Wholesale price data connections
- MESA-ESS
- Cost modeling for interconnection studies
- Improve bankability of StorageVET results with financing community

Post-Facto Reliability

Use Case Description

- Large military base in California wants to build a battery microgrid
 - Back up critical loads
 - Reduce electricity costs
- ~15 MW load
- ~4 MW Critical Load
- **\$8.77/kW**
Demand Charges
- TOD Energy Charges

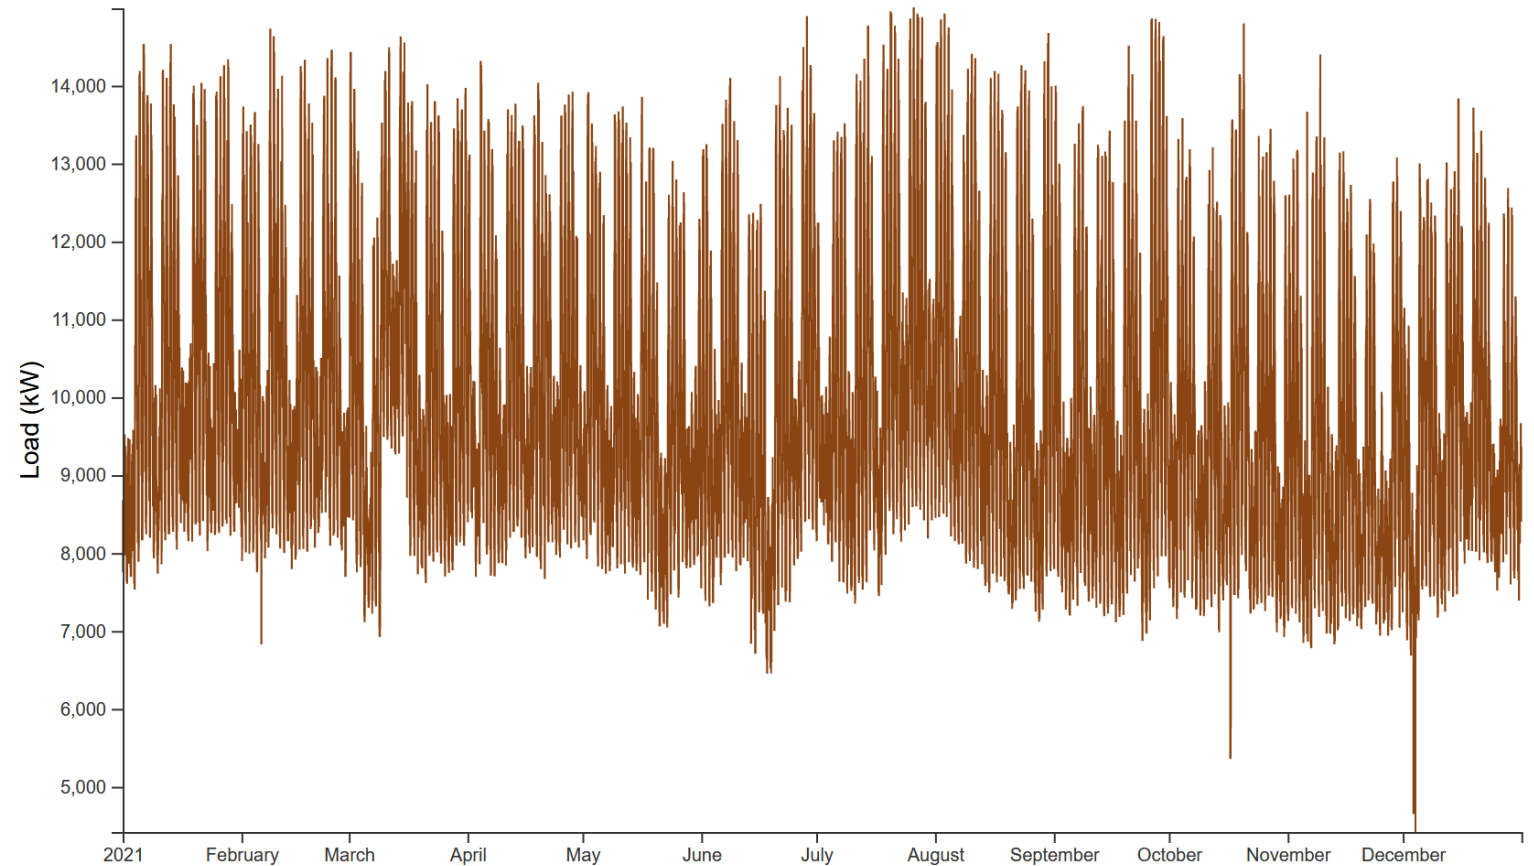

Analysis Objectives

- What is the economic optimum battery size?
 - Power capacity
 - Energy capacity
- Given the optimum size/operation, how much critical load could the battery cover?
 - Depends on state of charge and size

Define General Project Parameters

Project Configuration

Technology Specifications

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Scenario Analysis

Summary

Project Configuration

Project Name **CEC In-Person Demo** Name of the project, used to differentiate this case from any other the user has run before.

Start Year 2021

Analysis Window

Analysis Horizon Mode ☒ User-defined analysis horizon ☐ Auto-calculate analysis horizon ☐ Use carrying cost Defines when/how to end CBA analysis.

Analysis Horizon 20 years

The number of years the analysis will go for. The analysis will not consider equipment lifetime or anything else when determining the number of years to run for.

Grid Domain and Ownership Model

Technology Specifications

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Scenario Analysis

Data Year

2021

** Note: Analysis for a scenario where the data year comes before the start year has not yet been implemented. You must enter a data year that is the same or after the project start year.*

DER-VET uses exactly one year of data. If the year this data comes from is different from the year the optimization is run against, it will be escalated from the data year to the optimization year.

Grid Domain

☒ Customer

☐ Distribution

☐ Transmission

☐ Generation

Which grid domain the project will be connected to. This limits which services are available.

Ownership

☒ Customer

☐ Utility

☐ 3rd Party

Who owns the assets.

17

www.epri.com

© 2020 Electric Power Research Institute, Inc. All rights reserved.

EPRI

ELECTRIC POWER
RESEARCH INSTITUTE

Physical Location for Tariff and Solar Data

Technology Specifications

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Scenario Analysis

Summary

Physical Location:

Address for this project


Go

Enter the address for this project.

Latitude: 34.280492

Longitude: -119.294520


 **Locate Current Address**

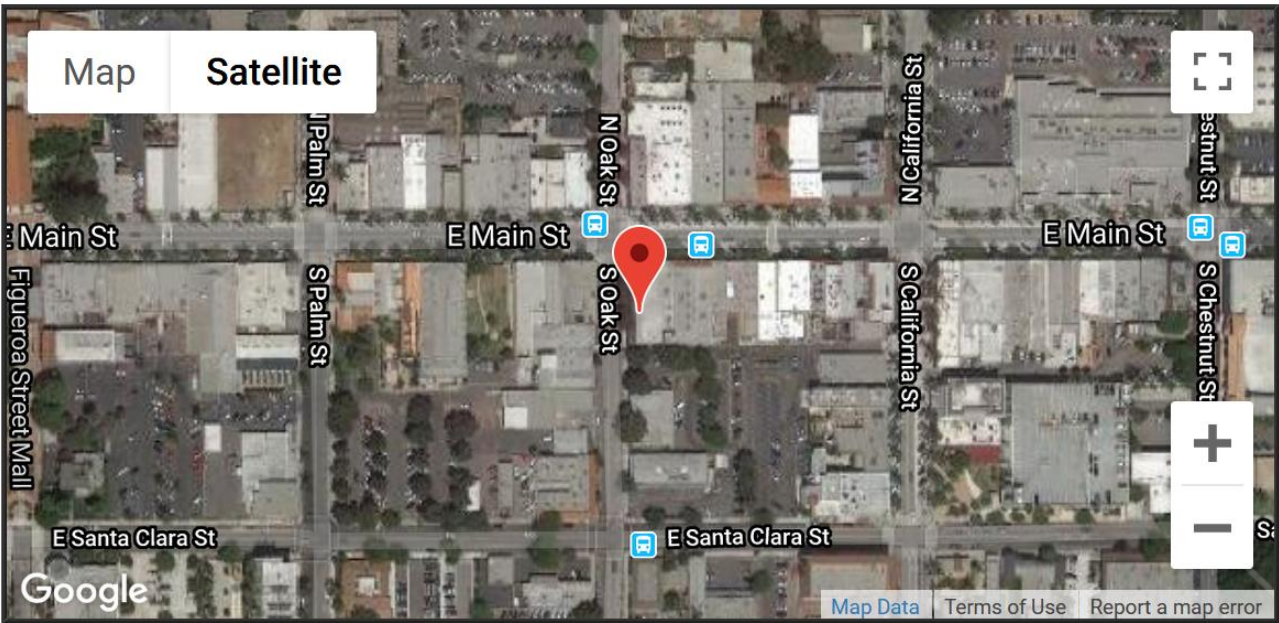

Add a Battery System

DER-VET

Projects ▾

 All Results

Catalogs ▾

Project Configuration

Technology Specifications ▾

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Technology Specs

Select a technology to add:

Solar PV

Battery Storage

Internal Combustion Engine

Project Configuration

Technology Specifications

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Scenario Analysis

Summary

Technology Specs: Battery Storage

 Battery Catalog

Name

Battery



Energy Capacity Sizing

☒ Have DER-VET size the Energy Capacity☐ Known size

Power Capacity Sizing

☒ Have DER-VET size the Power Capacity☐ Known size

Roundtrip Efficiency

91.0 %

What is the AC roundtrip efficiency of the storage system? Only this single number is considered - no variable efficiency is modeled.

Target SOC

100.0 %

What state of charge should the battery storage system return to at the end of each optimization window?

Self-Discharge Rate

%/hour

What is the AC roundtrip efficiency of the storage system? Only this single number is considered - no variable efficiency is modeled.

Limit Daily Cycling

☐ Yes ☒ No

Constrain the battery storage system's daily discharge energy. When selected, this input limits the amount of discharge energy a battery can do in any 24-hr period to a maximum of its rated energy capacity * daily cycle limit.

Include Housekeeping Calculations

☐ Yes ☒ No

"Include Housekeeping Power" – Apply a constant AC power consumption that does not discharge the battery directly. This is usually associated with HVAC requirements and keeping all equipment on."

Include startup cost in the dispatch optimization?

☐ Yes ☒ No

Cost Function

Capital Cost

\$

What is the capital cost for the storage system?

Capital Cost per kW

\$/kW

What is the capital cost per kW for the storage discharge power capacity?

Capital Cost per kWh

\$/kWh

What is the capital cost per kW for the storage energy capacity?

Fixed O&M Costs

\$/kW-year

What is the cost of fixed operations and maintenance for the battery storage system?

End of Life Expenses (\$)

How much will it cost to decommission the battery at its end of life? This cost is applied at the end of life of the battery system in nominal dollars.

Construction Date

01 / 01 / 2021

✕

Operation Date

01 / 01 / 2021

✕

MACRS Term

-

▼

years

Which MACRS GDS category does the battery storage system fall into?

[Project Configuration](#)[Technology Specifications](#)[Battery Storage \(1\)](#)[Services](#)[Site Information](#)[Financial Inputs](#)[External Incentives](#)[Retail Tariff](#)[Scenario Analysis](#)[Summary](#)

Services

Where do energy prices come from?

- **Retail tariff, PPA, or other fixed contract (define energy price structure)**

Will the project be reducing energy charges on a retail electricity bill?

Customer Services

- ☐ **Reliability/Resilience**

Define a number of hours the site must be capable of covering a grid outage for. DER-VET will size and operate the DERs to guarantee coverage for outages of this duration.

- ☐ **Backup Power**

Reserve a fixed amount of energy capability in case of an outage. Unlike the reliability service, this will not impact DER sizing and the energy reservation will not depend on the load.

☒ **Retail Demand Charge Reduction**

Will the project be reducing demand charges on a retail electricity bill?

Wholesale Services

There are no wholesale services available because your project does not include a battery or because there are technologies that are not explicitly sized.

** Note: The Backup Power service has not yet been implemented. You must select at least one objective that is not backup power.*

Other

You cannot define custom storage system settings because your project does not include a battery that is explicitly sized.

<< Back

Save and Continue

[Project Configuration](#)[Technology Specifications](#)[Battery Storage \(1\)](#)[Services](#)[Site Information](#)[Financial Inputs](#)[External Incentives](#)[Retail Tariff](#)[Scenario Analysis](#)[Summary](#)

Services: Site Information

☐ **Prevent power import from the grid (self-generation only)**

Will the project be required to island and ride through an outage of a specified duration?

☐ **Prevent power export to the grid (self-consumption only)**

Will the project be required to island and ride through an outage of a specified duration?

Site load data has already been uploaded for this project. Do you want to use the existing data?

☒ **Yes** ☐ **No, upload new data**


<< Back

Save and Continue

[Project Configuration](#)[Technology Specifications](#)[Battery Storage \(1\)](#)[Services](#)[Site Information](#)[Financial Inputs](#)[External Incentives](#)[Retail Tariff](#)[Scenario Analysis](#)[Summary](#)

Services: Site Load

Please take a moment to review the Site Load data for your project. Click the **Back** button below to upload different Site Load data, or click **Next** to continue using the below Site Load data.

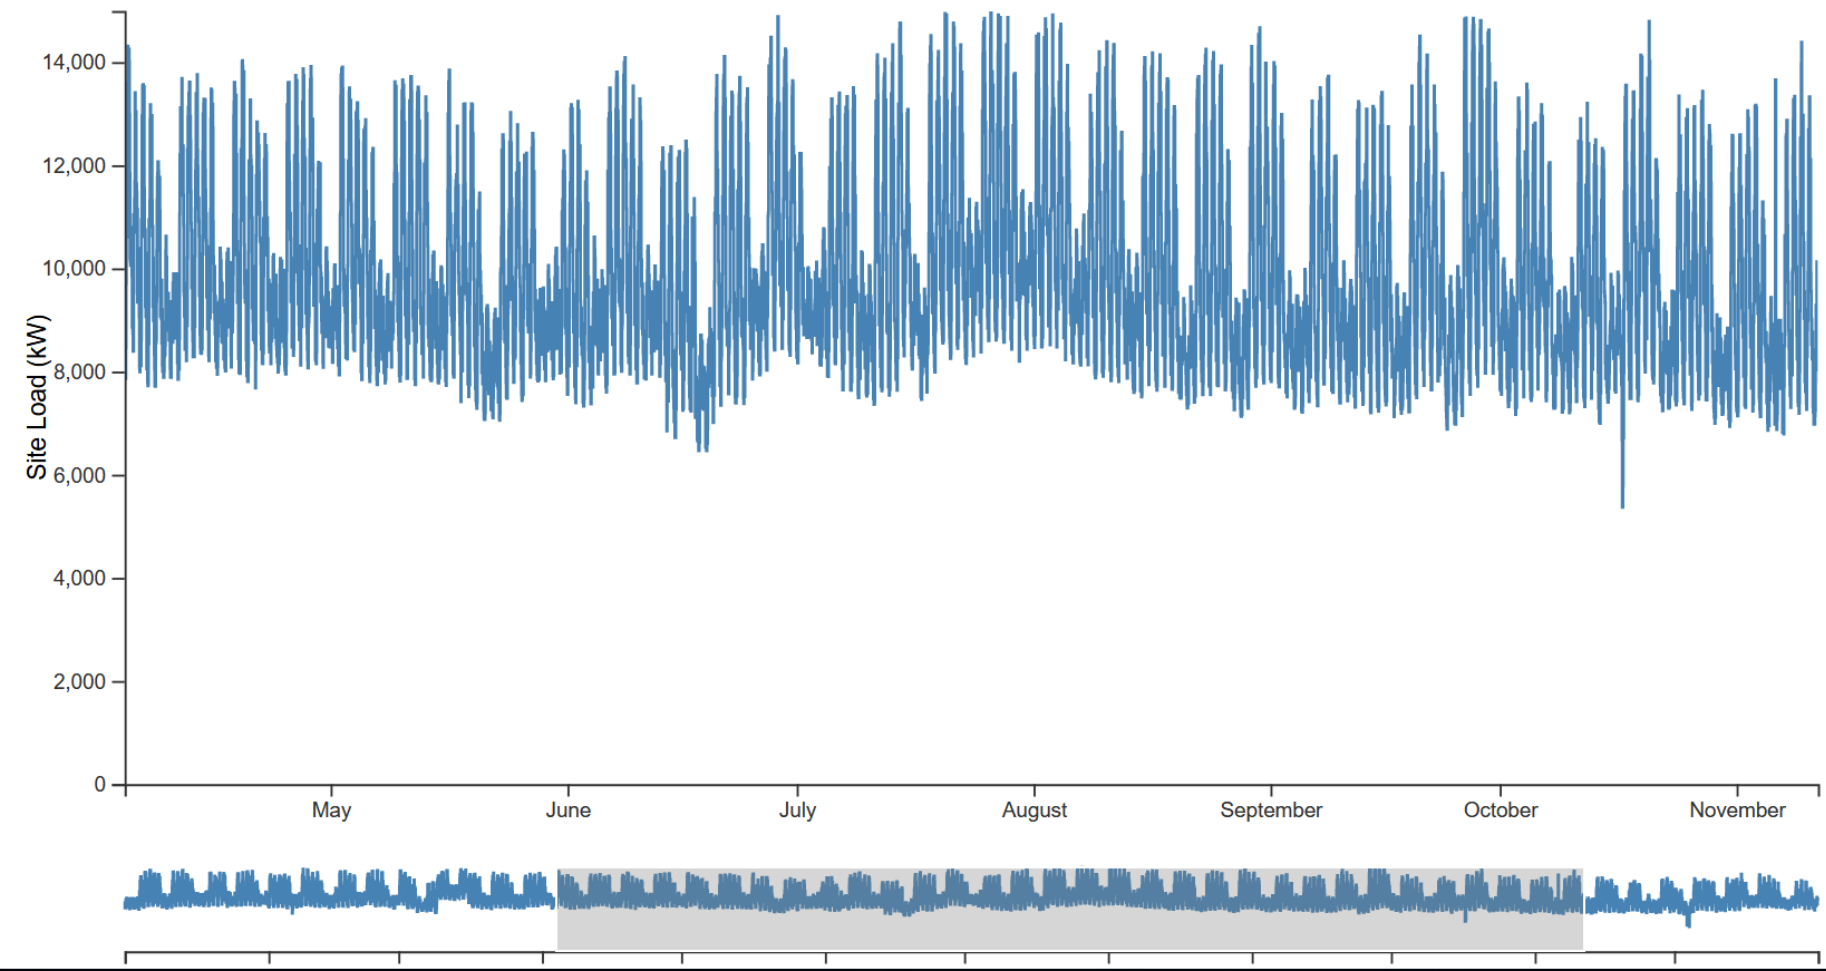

[Project Configuration](#)[Technology Specifications](#)[Battery Storage \(1\)](#)[Services](#)[Site Information](#)[Financial Inputs](#)[External Incentives](#)[Retail Tariff](#)[Scenario Analysis](#)[Summary](#)

Financial Inputs

Discount Rate (for discounted cash flow analysis)

%

What is the discount rate to be used in the financial analysis? (Note: in the future, we will build calculators for this based on loan terms, return on equity, etc.)

Inflation Rate

%

What is the inflation rate to be used in the financial analysis?

Federal Tax Rate

%

State Tax Rate

%

Property Tax Rate

%

[<< Back](#)[Save and Continue](#)

Project Configuration

Technology Specifications

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Scenario Analysis

Summary

Retail Tariff

Import Tariff

Export Tariff

OpenEI Tariff

Build a retail tariff definition by: entering the billing periods one at a time; or by importing a tariff file from an export file; or by importing a tariff from OpenEI.

Rate Table

Energy Heatmap

Demand Heatmap

	Name	Period	Coverage	Day of Week	Value	Charge	Remove All
Edit	0 indicates that the period applies to weekends	1	January - May 12:00 AM - 08:00 AM (8 hours)	Weekdays	\$0.0676	Energy	Remove
Edit	1 indicates that the period applies to weekdays	2	January - May 08:00 AM - 09:00 PM (13 hours)	Weekdays	\$0.0779	Energy	Remove
Edit		3	January - May 09:00 PM - 12:00 AM (3 hours)	Weekdays	\$0.0676	Energy	Remove
Edit		4	January - May 12:00 AM - 12:00 AM (24 hours)	Weekends	\$0.0676	Energy	Remove
Edit		5	June - September 12:00 AM - 08:00 AM	Weekdays	\$0.062	Energy	Remove

Project Configuration

Technology Specifications

Battery Storage (1)

Services

Site Information

Financial Inputs

External Incentives

Retail Tariff

Scenario Analysis

Summary


Weekdays

Month	00	01	02	03	04	05	06	07	08	09	10	11	12	13	14	15	16	17	18	19	20	21	22	23
January	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
February	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
March	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
April	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
May	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
June	1	1	1	1	1	1	1	1	4	4	4	4	5	5	5	5	5	5	4	4	4	4	4	1
July	1	1	1	1	1	1	1	1	4	4	4	4	5	5	5	5	5	5	4	4	4	4	4	1
August	1	1	1	1	1	1	1	1	4	4	4	4	5	5	5	5	5	5	4	4	4	4	4	1
September	1	1	1	1	1	1	1	1	4	4	4	4	5	5	5	5	5	5	4	4	4	4	4	1
October	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
November	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2
December	2	2	2	2	2	2	2	2	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2

Results Summary Page

DER-VET

Projects ▾

 All Results

Catalogs ▾

mevans@epri.com

Log off

Project Summary

Results

Financials

Dispatch

Design

<< All Results


Open Project

Result #5

 Download Input Files

 Download Results

Financials Summary

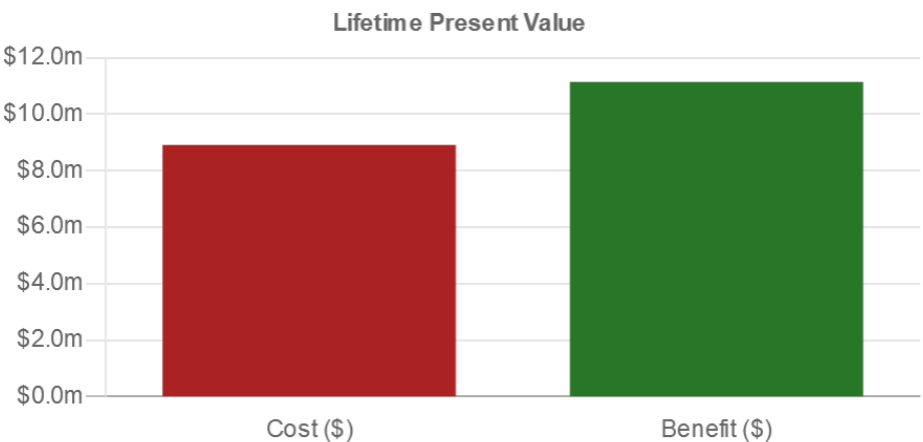


View Detailed Financials Results...

Reliability Summary


No Reliability Contribution results to show.

Results Summary Page (Cont)

Dispatch Summary

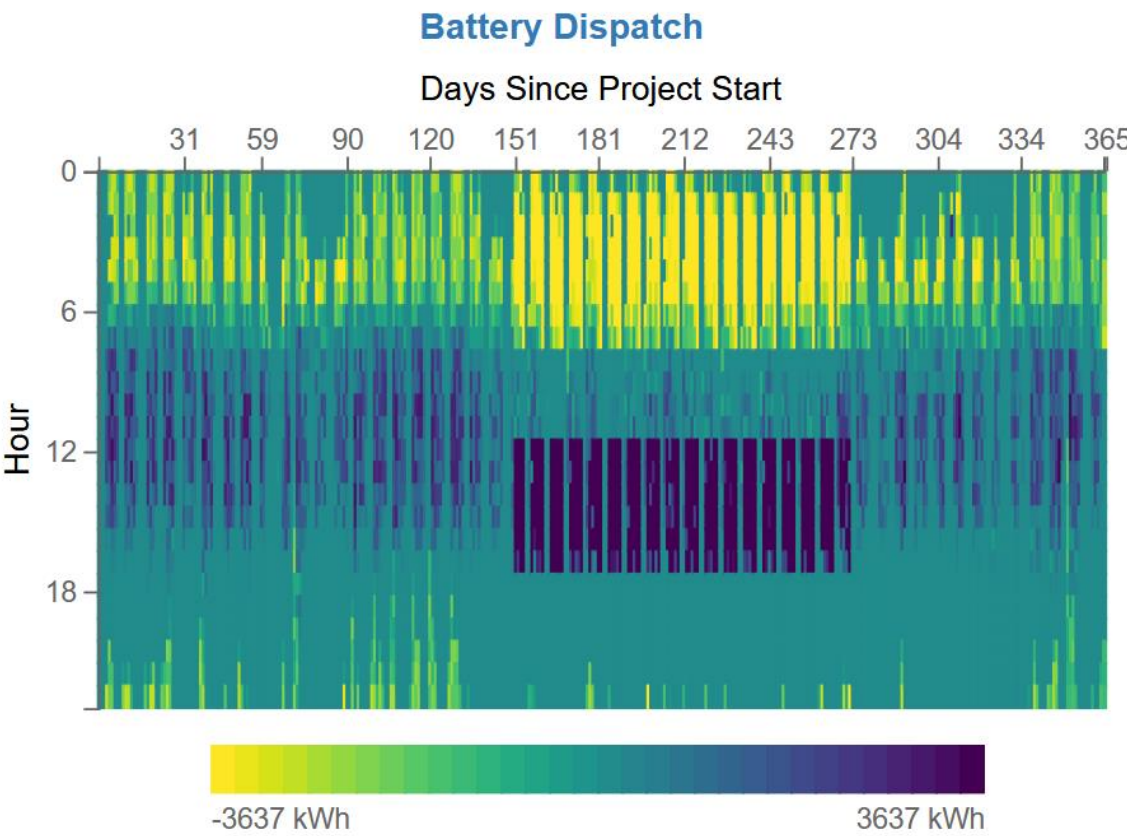


Design Summary

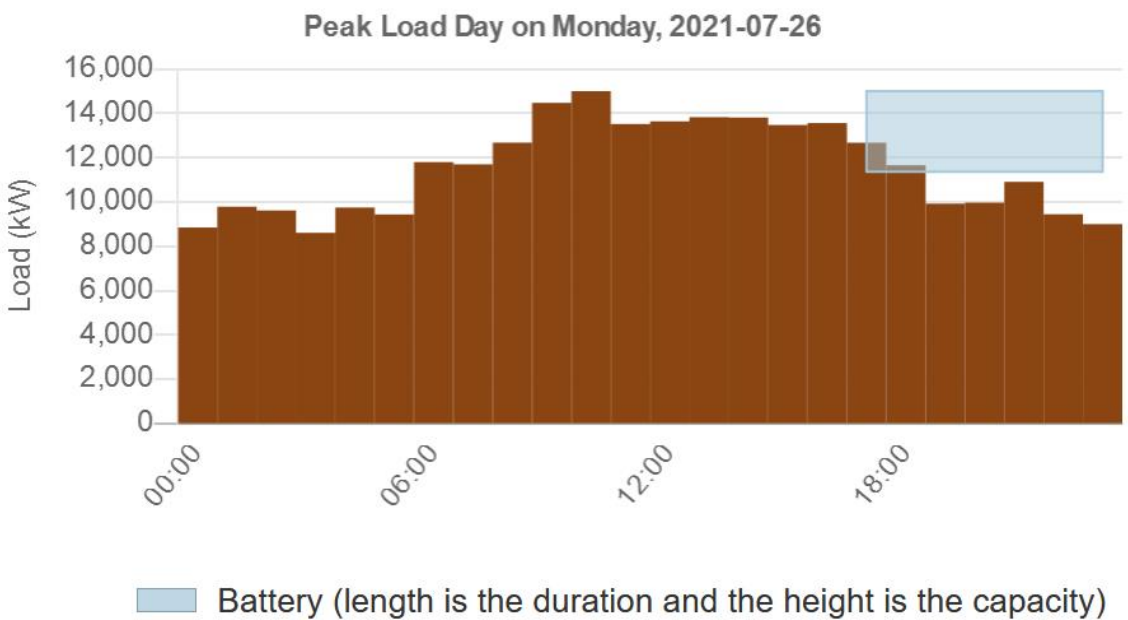


[View Detailed Design Results...](#)

Financial Results

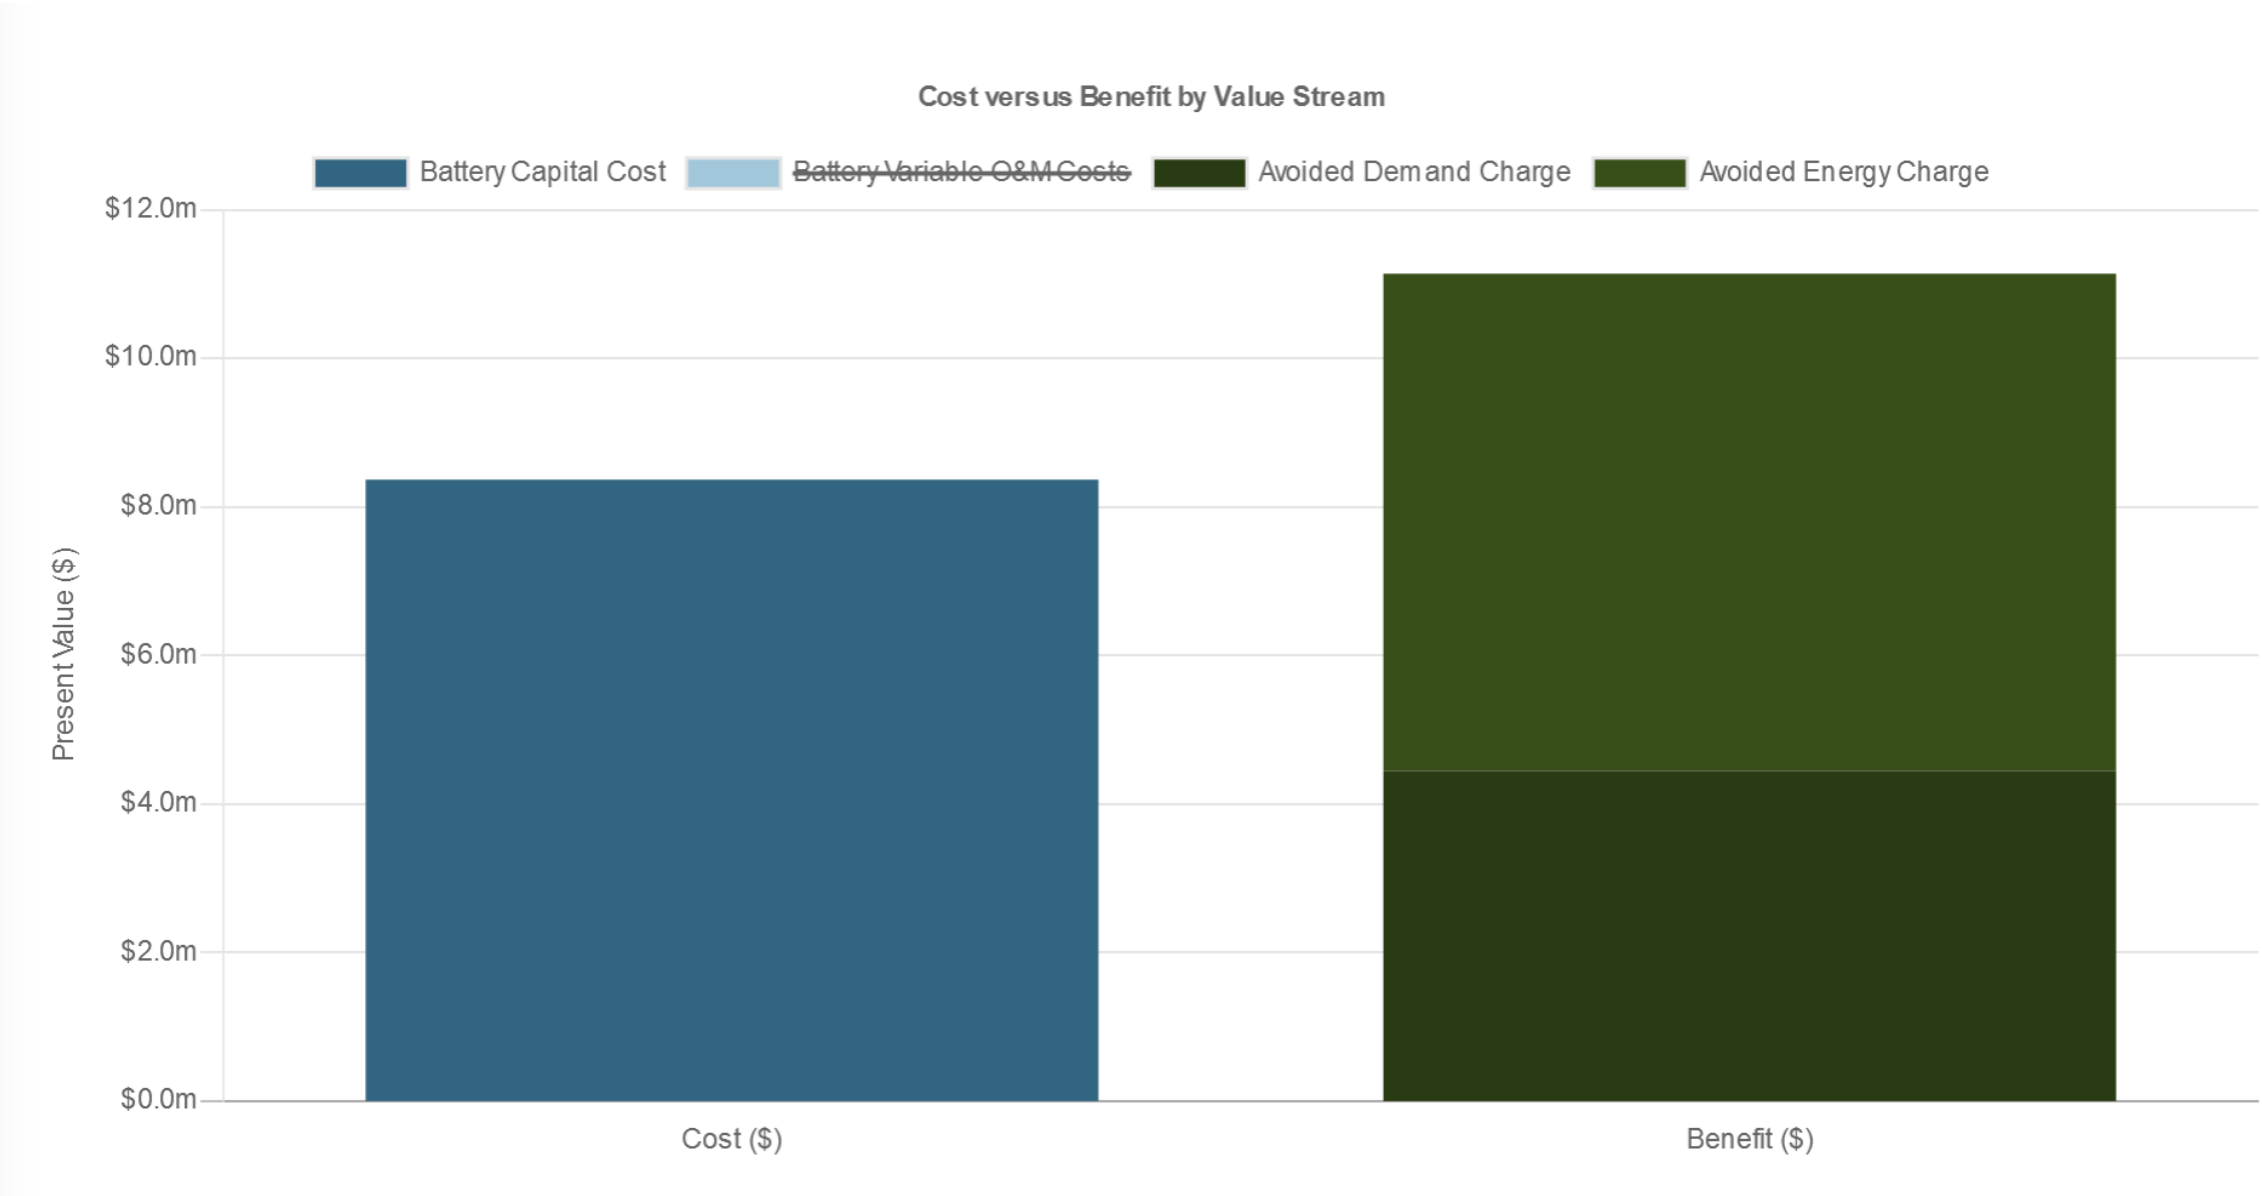


Before and After Monthly Energy Bill for 2021

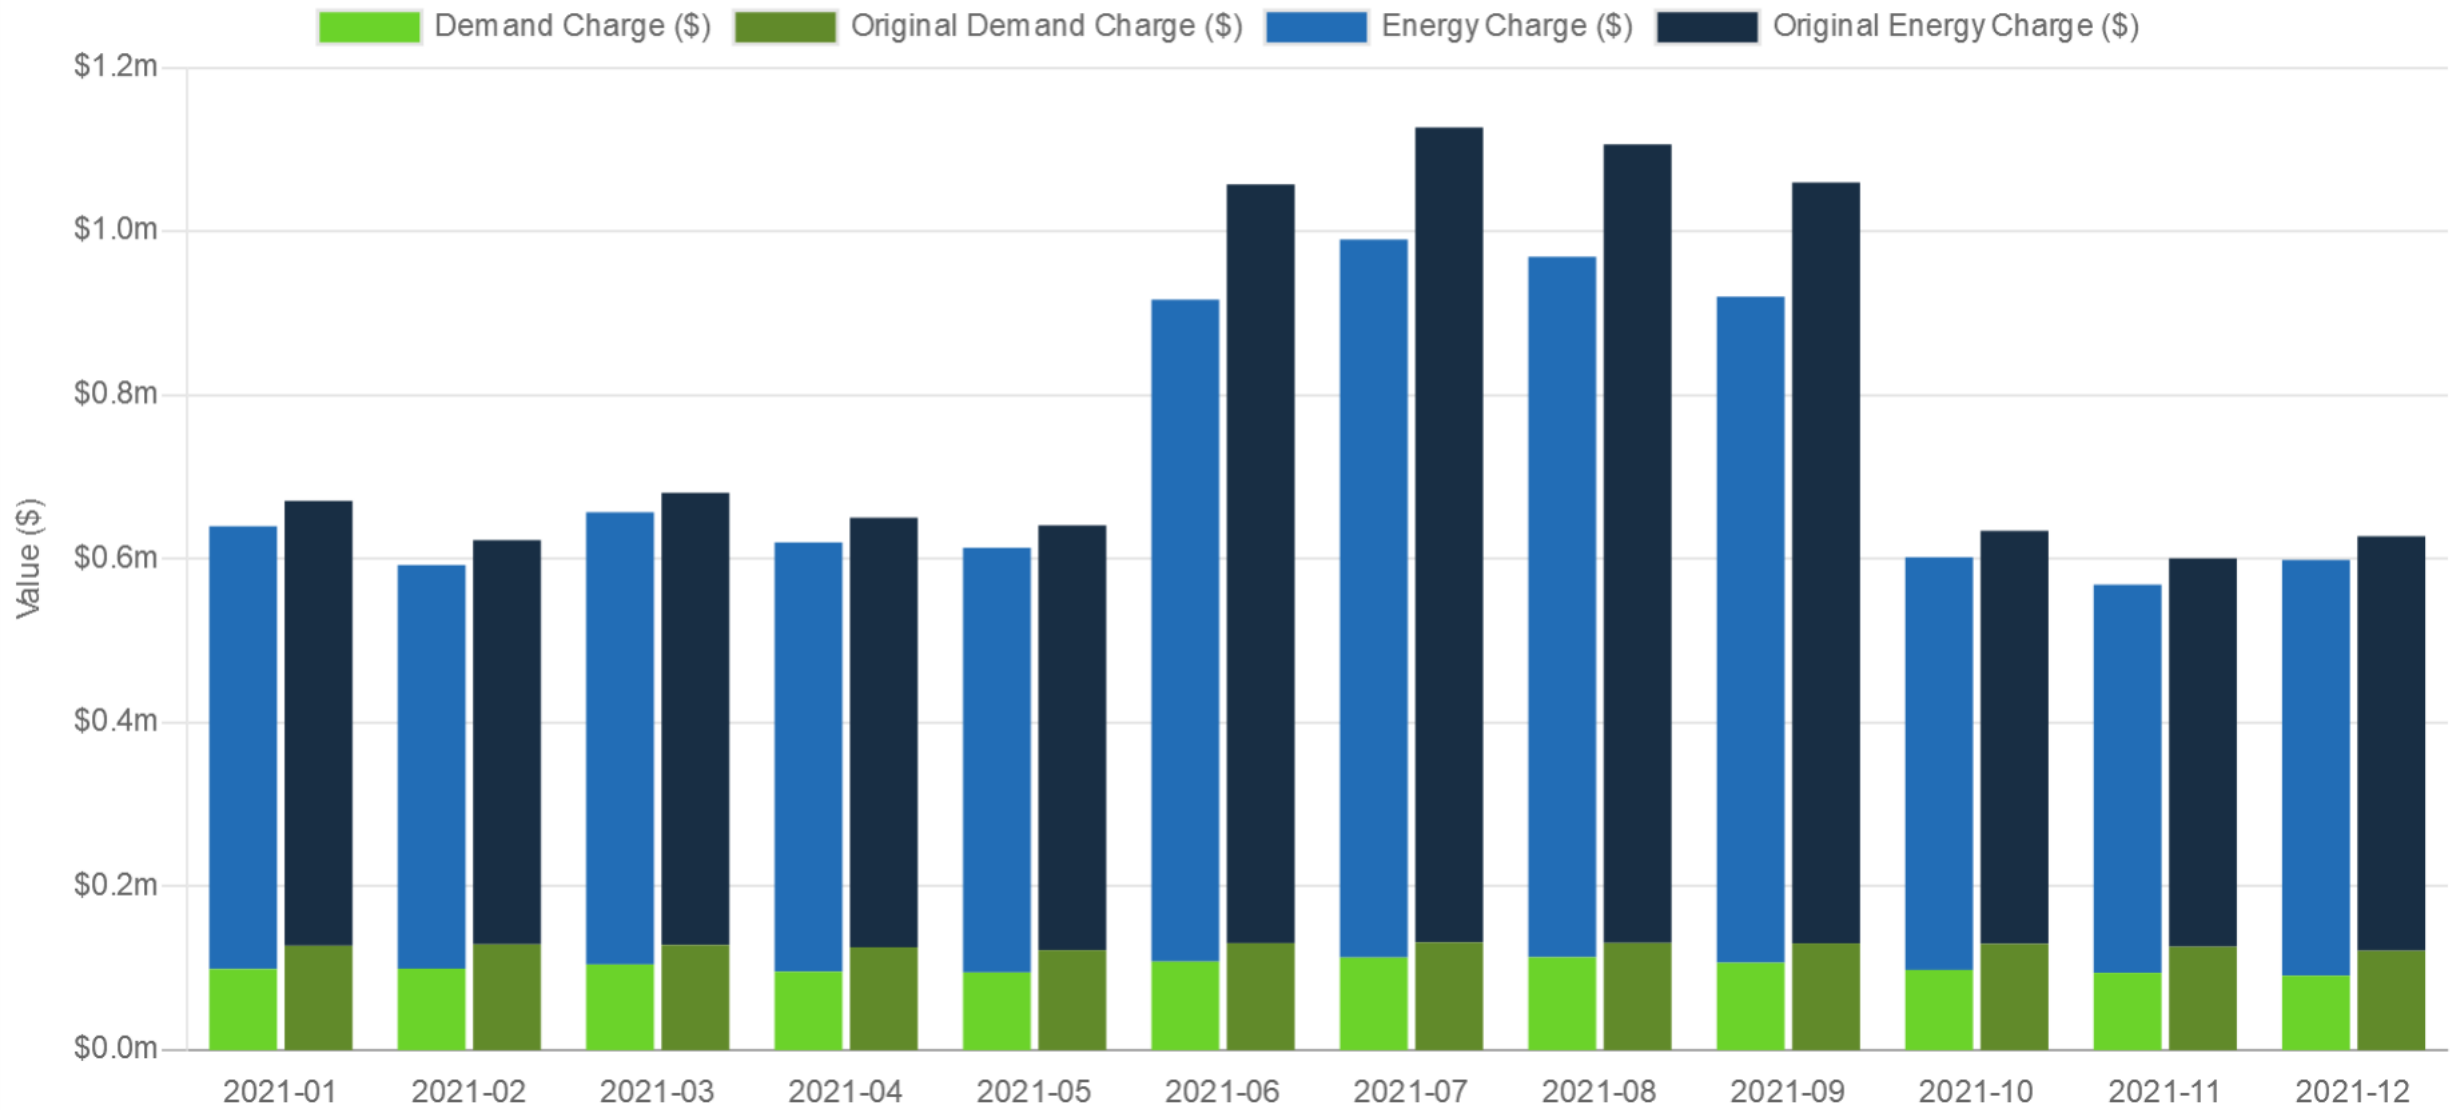


Pro-forma (Nominal Cash Flow)

Year	Avoided Demand Charge	Avoided Energy Charge	Battery Capital Cost	Battery Fixed O&M Cost	Battery Variable O&M Costs
CAPEX Year	\$0	\$0	-\$8,365,350	\$0	\$0
2021	\$315,458	\$474,998	\$0	\$0	-\$38,479
2022	\$322,398	\$485,448	\$0	\$0	-\$39,326
2023	\$329,491	\$496,128	\$0	\$0	-\$40,191
2024	\$336,739	\$507,043	\$0	\$0	-\$41,075
2025	\$344,148	\$518,198	\$0	\$0	-\$41,979
2026	\$351,719	\$529,598	\$0	\$0	-\$42,902
2027	\$359,457	\$541,249	\$0	\$0	-\$43,846
2028	\$367,365	\$553,157	\$0	\$0	-\$44,811
2029	\$375,447	\$565,326	\$0	\$0	-\$45,797
2030	\$383,707	\$577,763	\$0	\$0	-\$46,804
2031	\$392,148	\$590,474	\$0	\$0	-\$47,834
2032	\$400,775	\$603,465	\$0	\$0	-\$48,886


Operational Results (Winter - Mostly Flat Energy Prices)

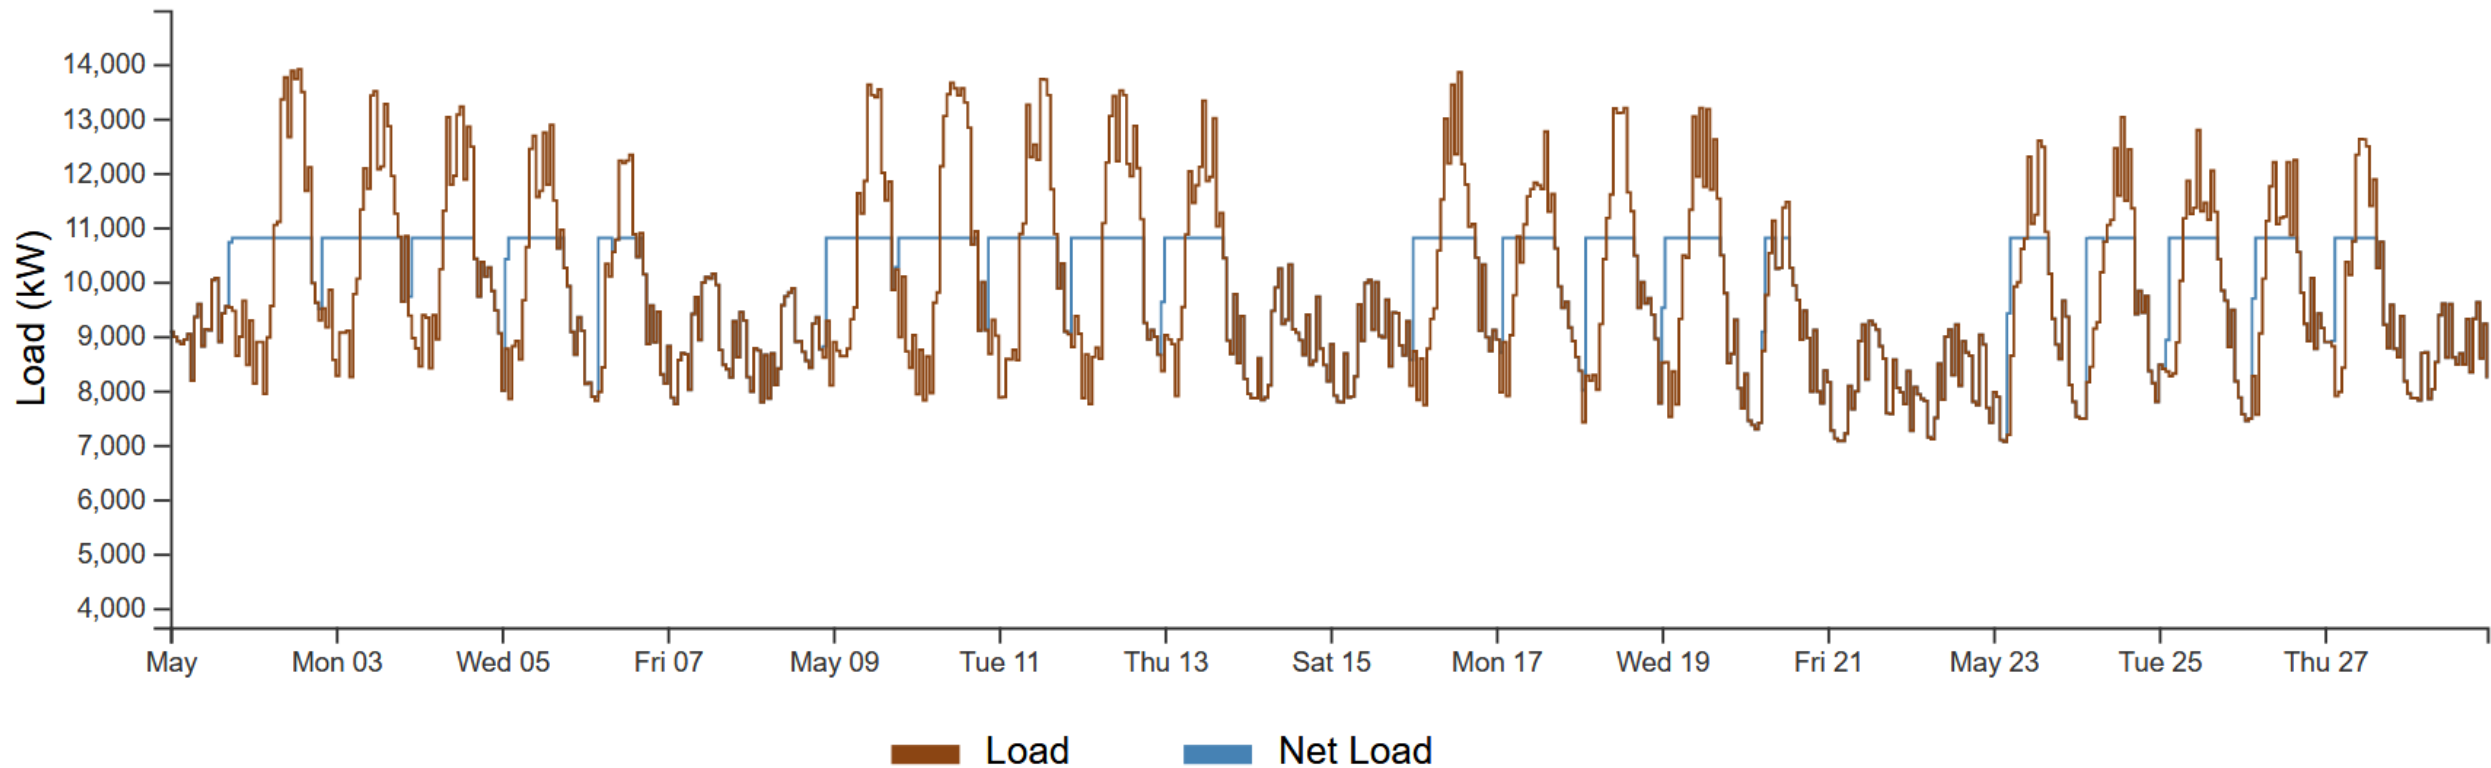

Operational Results (Summer – Strong TOD Energy Prices)

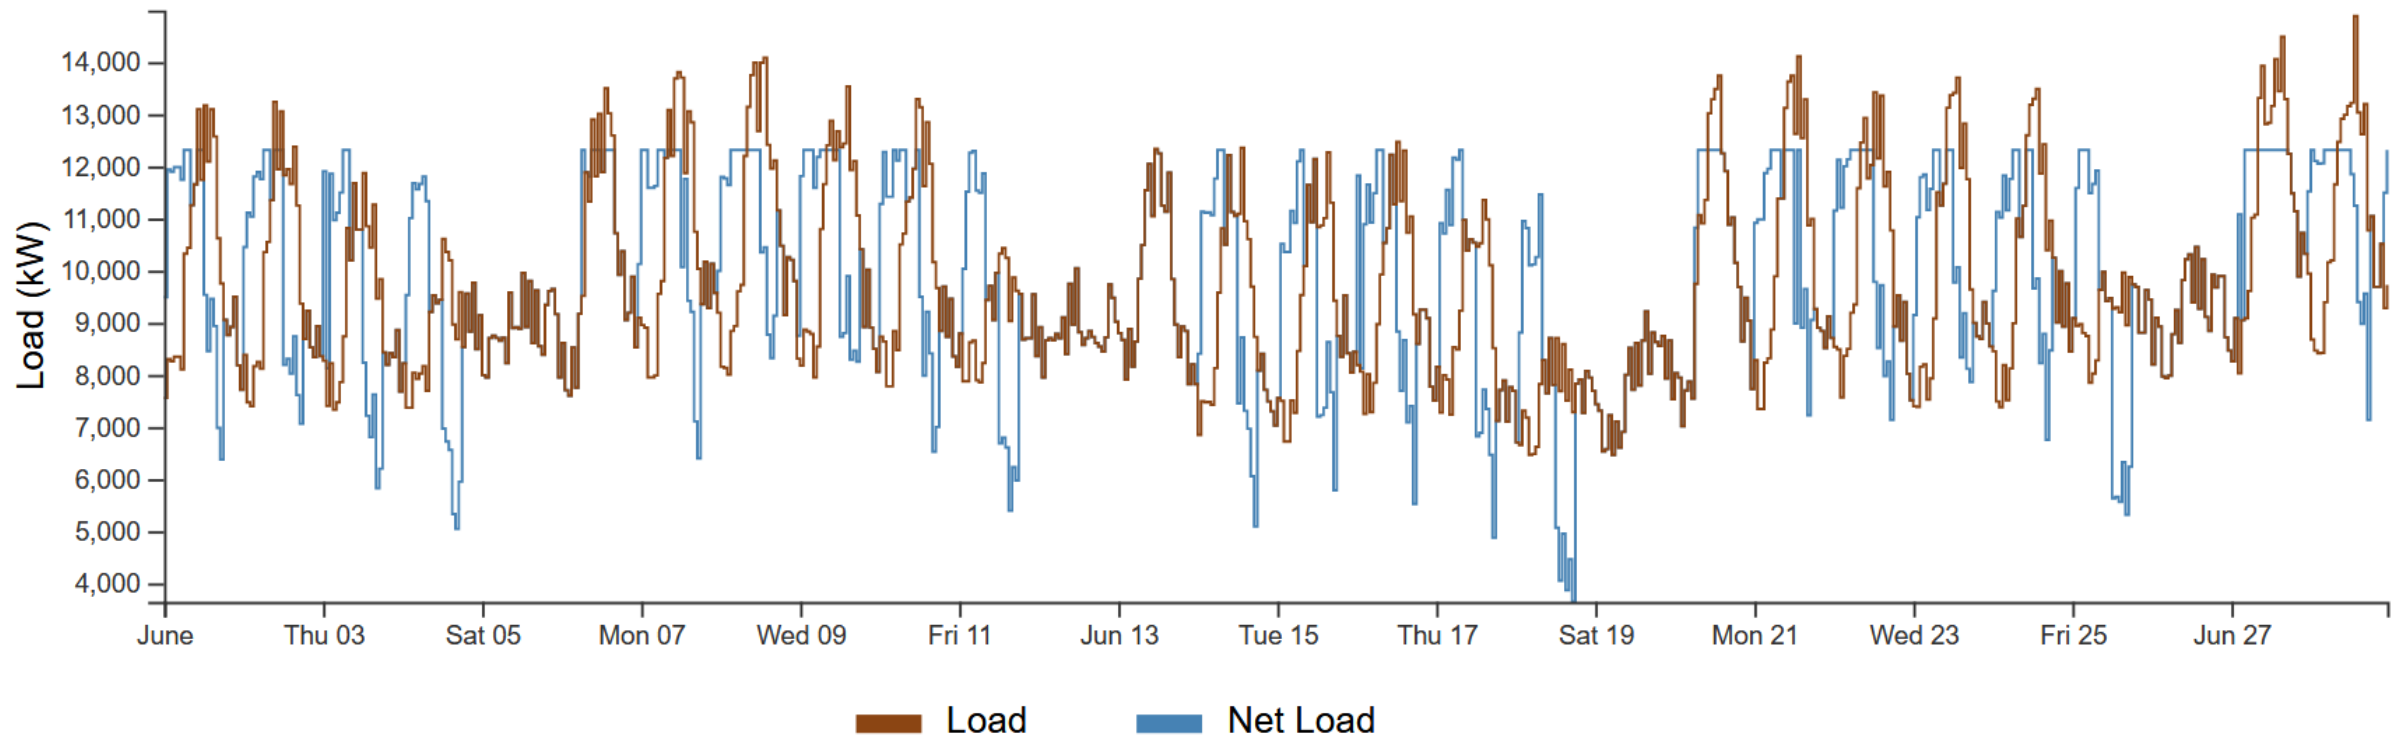

Energy Price Heat Map

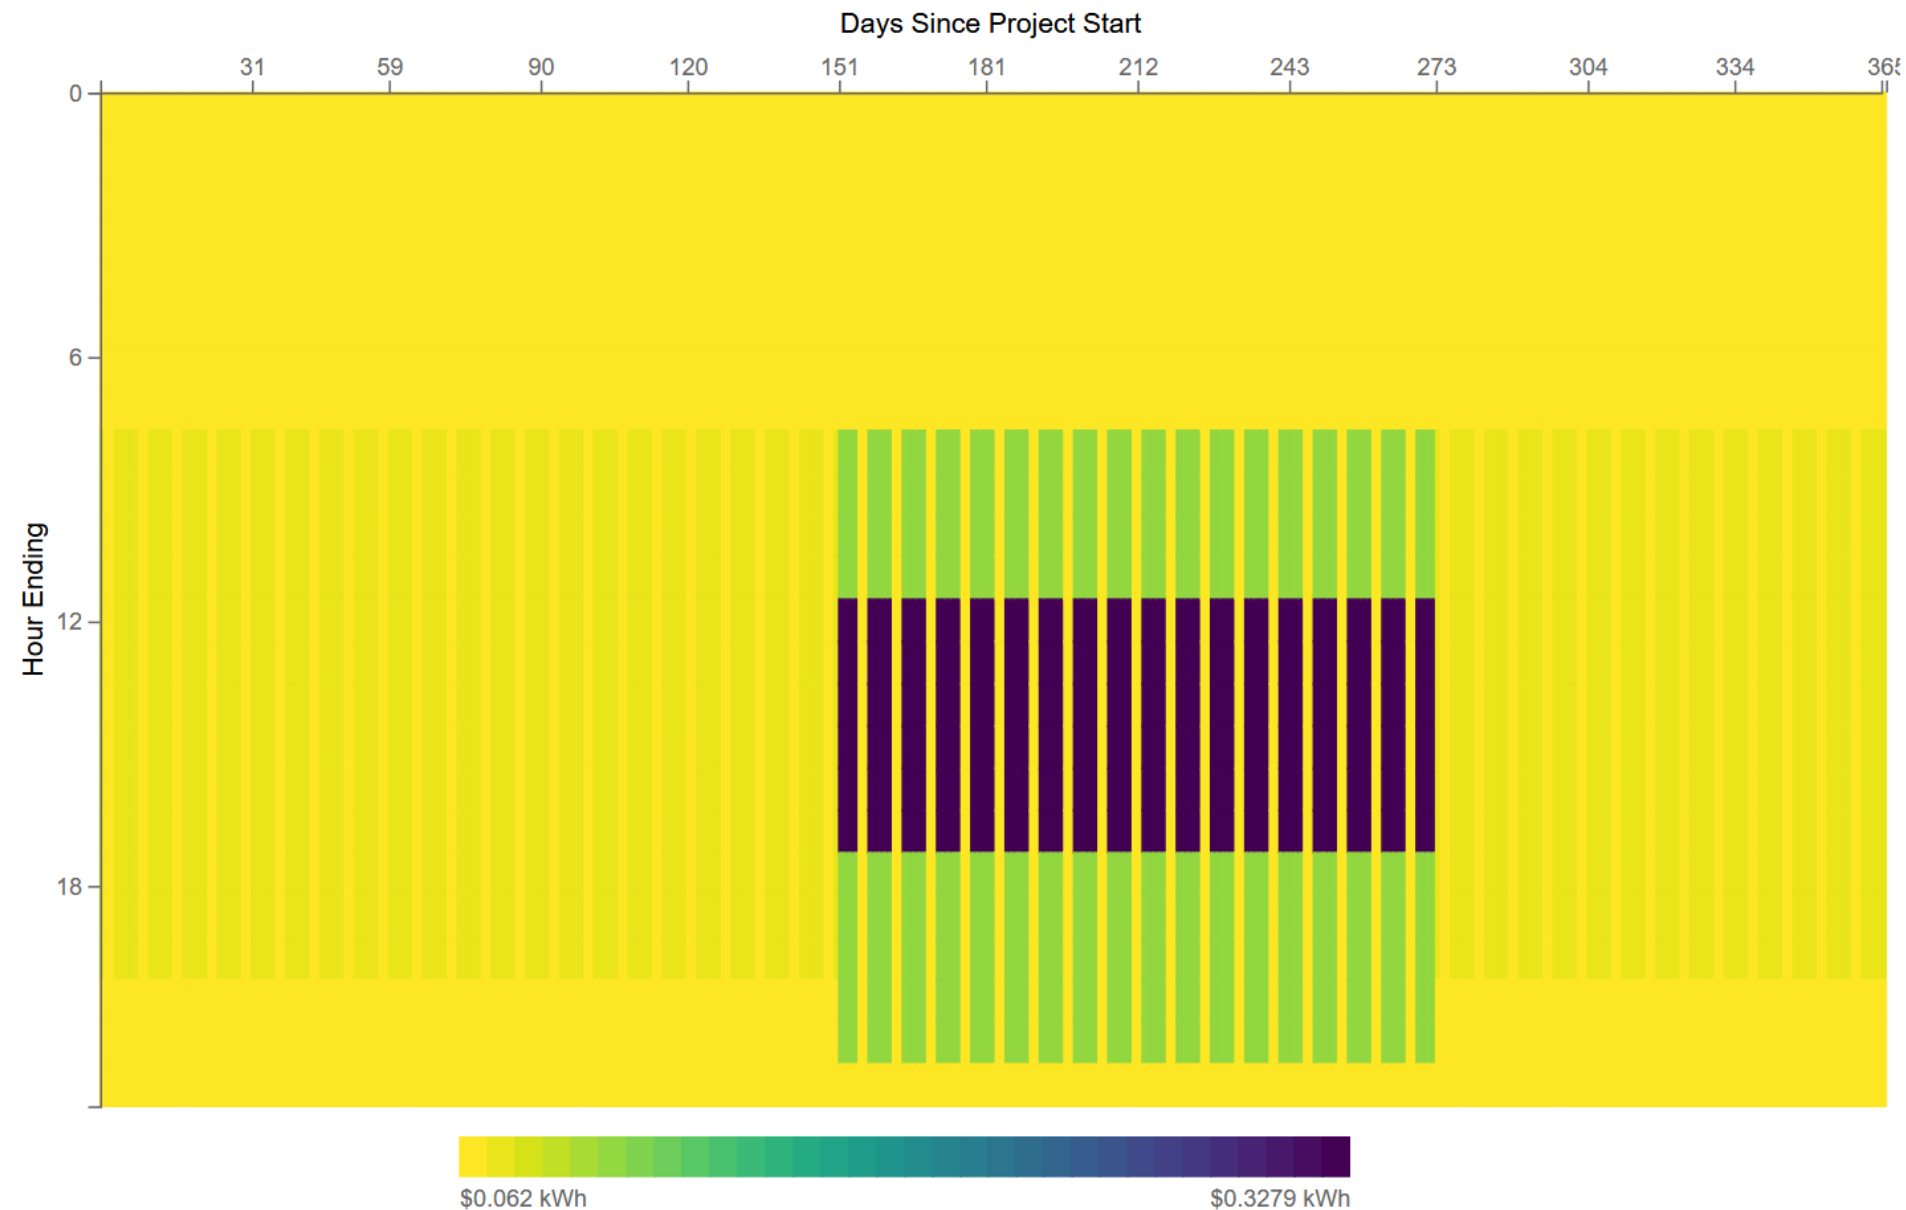

Size Results

System Name	Energy Rating (kWh)	Charge Rating (kW)	Discharge Rating (kW)	Duration (hours)	Power Capacity (kW)	Quantity
Battery	21,823.0000	3,637.0000	3,637.0000	6.0003	0.0000	1

Rated Power and Energy Cost

Costs for Battery		
\$8,365,350.00		Total Cost
\$0.00		Fixed Cost
\$5,455,750.00		Cost per kWh
= 21,823.0 kWh x \$250/kWh		
\$2,909,600.00		Cost per kW
= 3,637.0 kW x \$800/kW		

Conclusions


- The **maximum** demand charge savings for a 3,637 kW battery would be
 $\$8.77/\text{kW} * 3,637 \text{ kW} * 12 \text{ mo} = \mathbf{\$382,757/\text{year}}$
- Given the load and battery's energy capacity, this system could **optimally** achieve **\$315,548/year**
- A real system would likely **actually** achieve less than this depending on the quality of its control or real-world performance.

Conclusions

- **Optimal** energy charge savings: **\$474,998** per year
 - 20 years of consistent performance
 - Optimal result for 1 year does not consider degradation
 - **Actual** operation should be more conservative with the battery and result in lower energy charge savings.


Conclusions - Reliability

- Critical load > economically-optimal battery power capacity

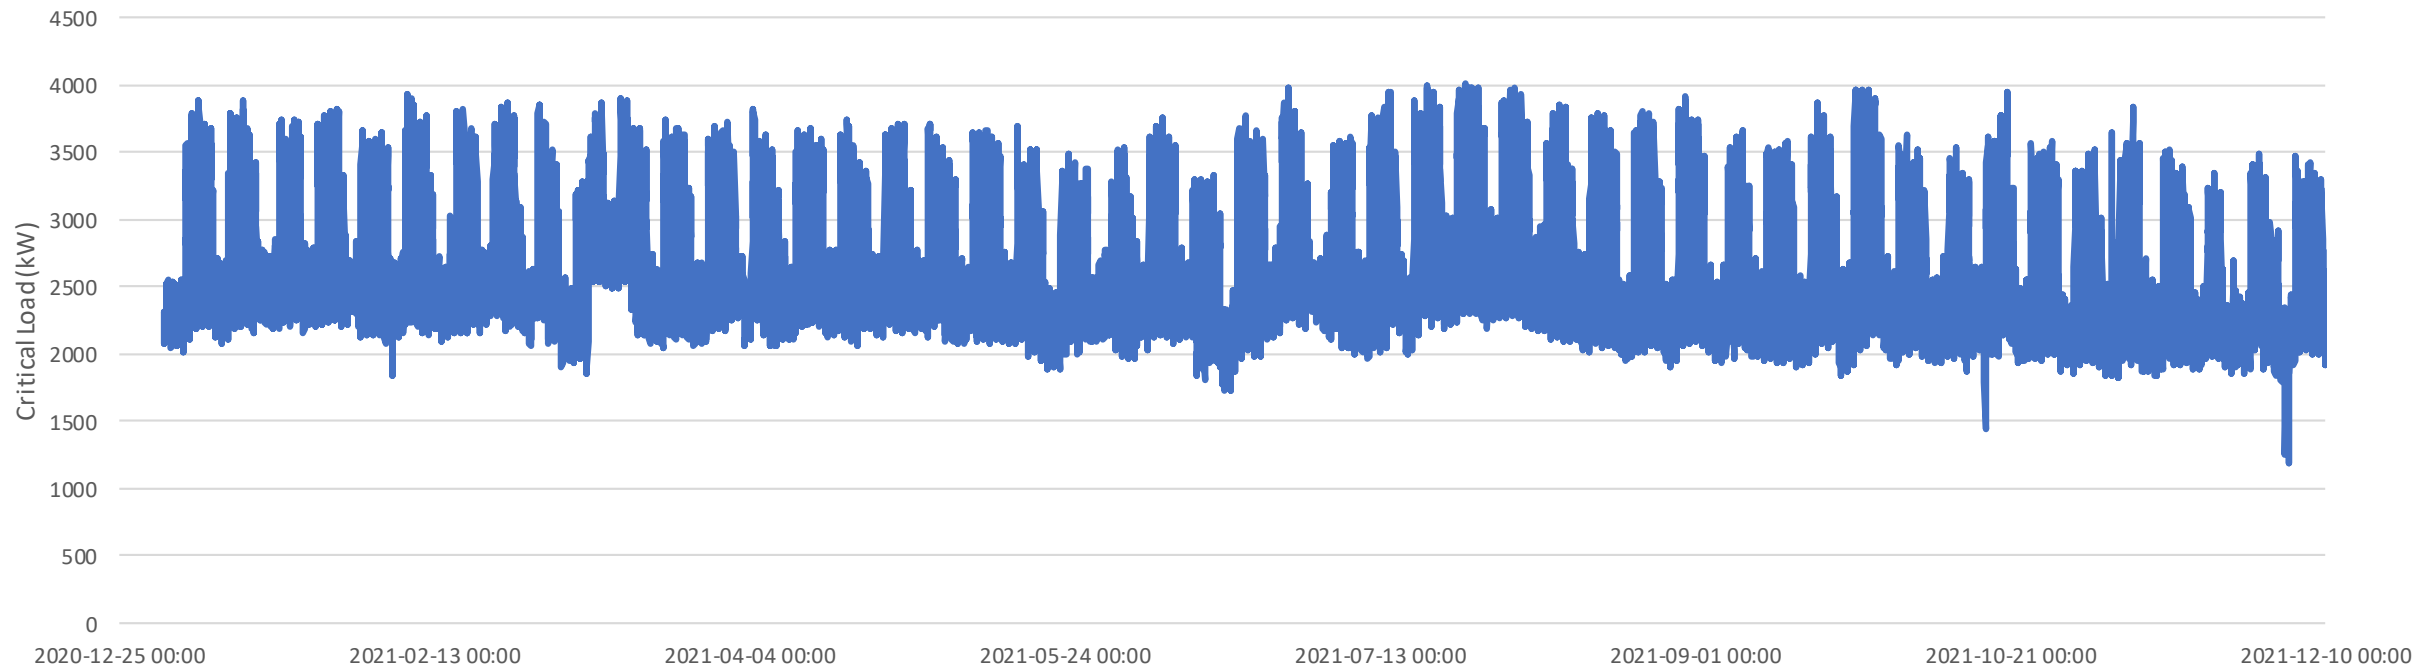


Conclusions - Reliability

- Battery is unlikely to cover a random outage.
 - Size not constrained or optimized for reliability
 - Operated to minimize SOC most of the time

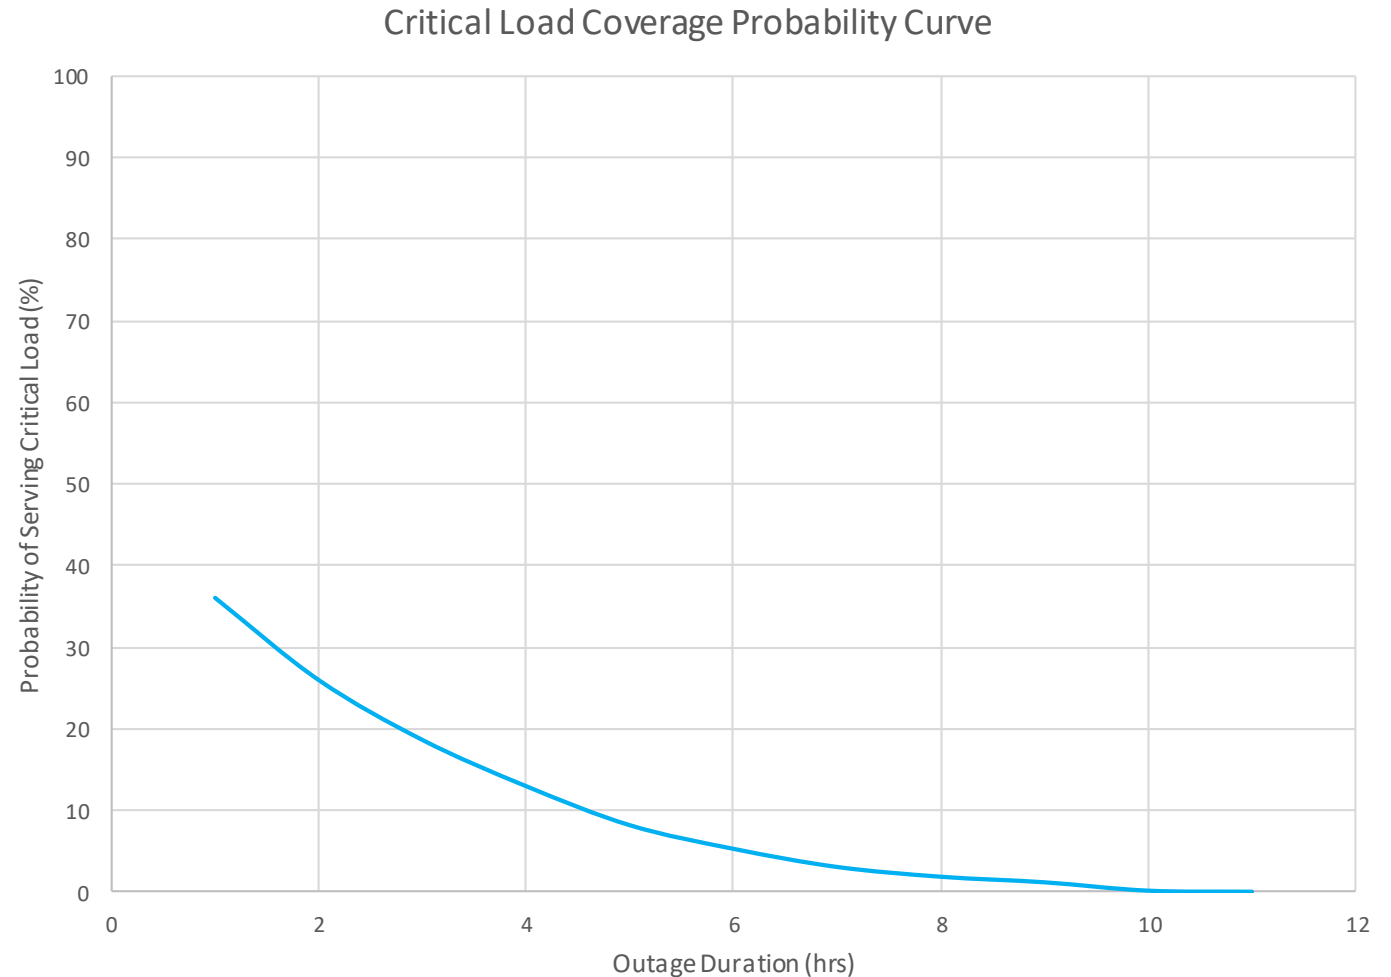

Conclusions – Should be Operated Differently for Reliability

- Next time
 - Set a minimum SOC
 - Optimize for reliability
 - Penalize low SOC

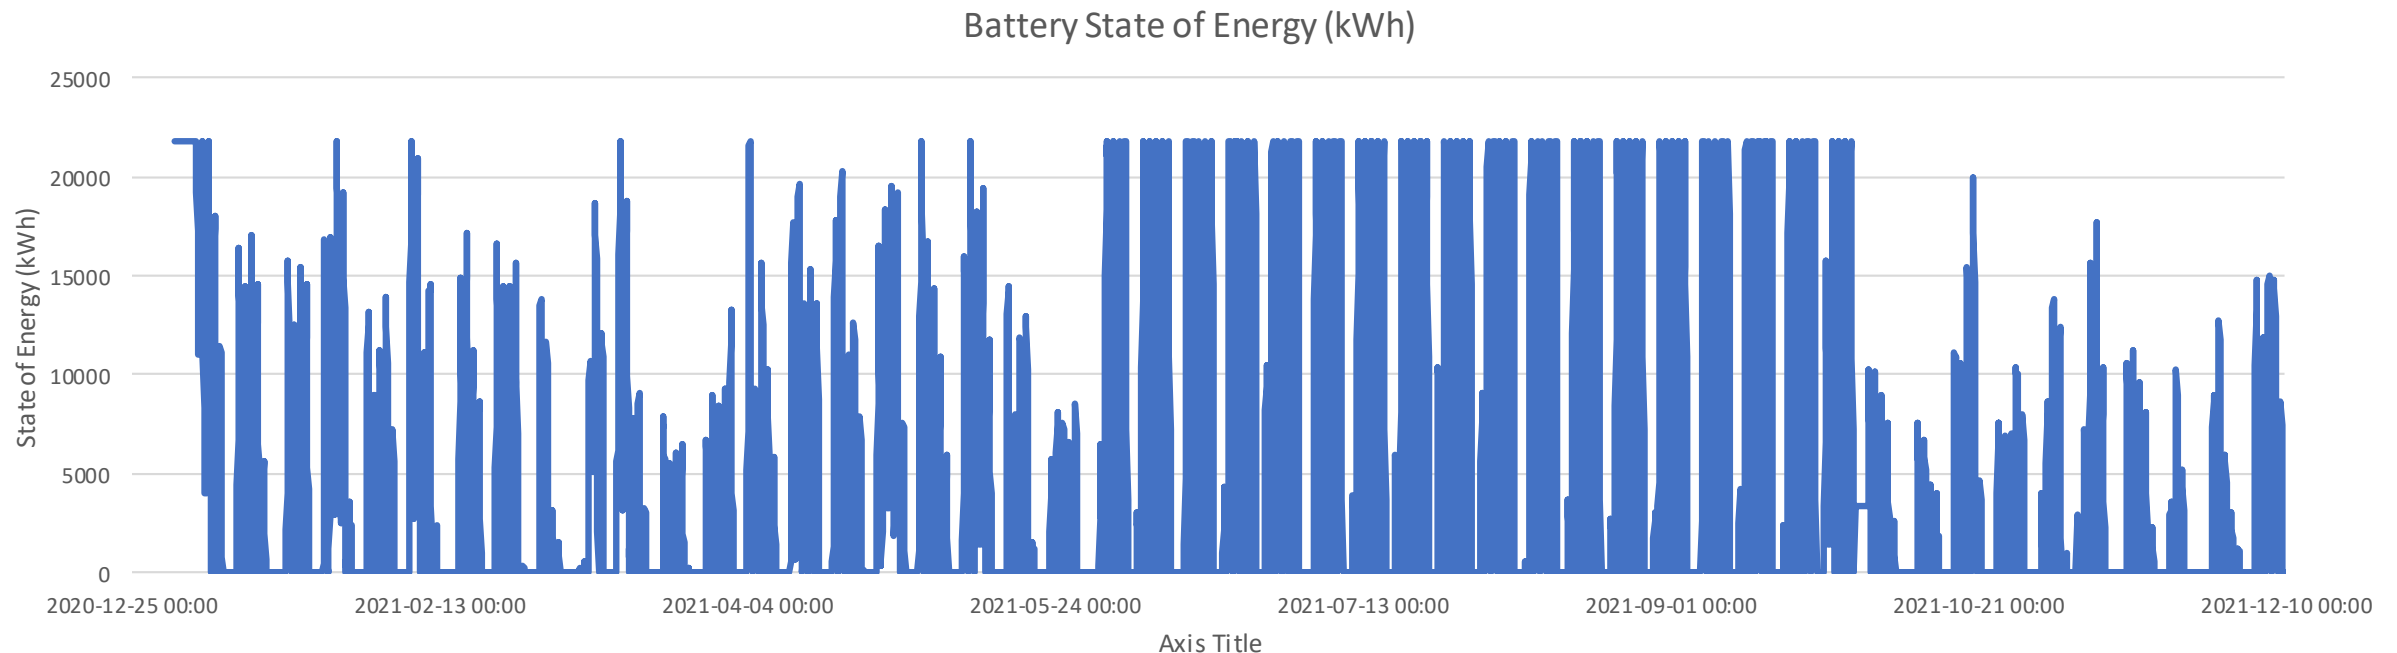

DER-VET Alpha Test Signup

Alpha Test Sign Up

- Sign up for a 30-minute alpha test here:
- <https://www.surveymonkey.com/r/GWGSNFZ>

Next Meeting

Regularly-Scheduled Meetings

- **Next Meeting – Thursday March 5, 11:00 am Pacific Time**

Together...Shaping the Future of Electricity